




STANDARD 2'-6" CURB AND GUTTER

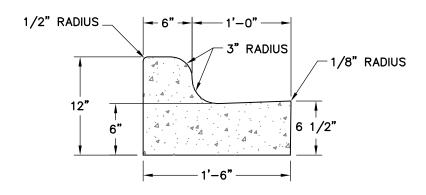

# 1'-6" STANDARD CURB AND GUTTER

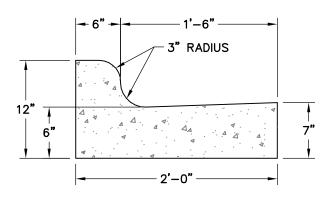

2'-0" STANDARD CURB & GUTTER

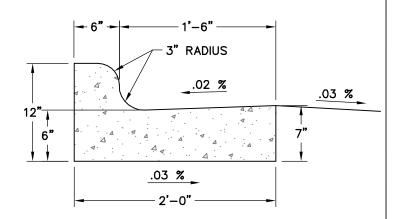

SLOPE FOR VARIABLE
SUPER ELEVATION RATES

	REVISIONS
DATE	DESCRIPTION

TOWN OF KNIGHTDALE


STANDARD DETAILS

(	0	T	J

CURB AND GUTTER

STD. NO.

4.01

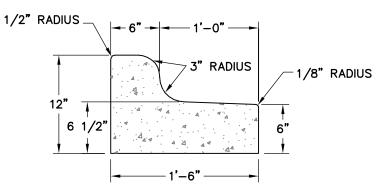


### 1'-6" MEDIAN CURB AND GUTTER

TO BE USED IN MEDIANS WHEN LANES ARE SLOPED FROM ISLAND OR AS SPECIFIED BY THE TOWN ENGINEER.


## 1'-6" MOUNTABLE CURB AND GUTTER

TO BE USED IN MEDIANS ONLY WHEN SPECIFIED BY THE TOWN ENGINEER.

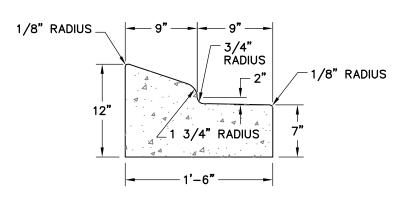


### 1'-6" BINDER CURB

TO BE USED IN ALLEYS ONLY WHEN SPECIFIED BY THE TOWN ENGINEER.



### 1'-6" STANDARD CURB AND GUTTER

	REVISIONS		
DATE	DESCRIPTION		
			2 of 3
ТО	WALCE ENICHTDALE		STD. NO.
	WN OF KNIGHTDALE TANDARD DETAILS	CURB AND GUTTER	4.01

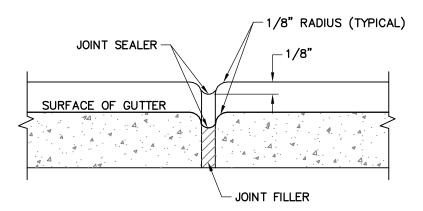

#### TRANSVERSE EXPANSION JOINT

#### NOTES:

- CONTRACTION JOINTS SHALL BE SPACED AT 10-FOOT INTERVALS. JOINT SPACING MAY BE ALTERED BY THE ENGINEER TO PREVENT UNCONTROLLED CRACKING.
- 2. CONTRACTION JOINTS MAY BE INSTALLED BY THE USE OF TEMPLATES OR FORMED BY OTHER APPROVED METHODS. WHERE SUCH JOINTS ARE NOT FORMED BY TEMPLATES, A MINIMUM DEPTH OF 1-1/2" SHALL BE OBTAINED.
- 3. ALL EXPANSION JOINTS SHALL BE SPACED AT 90-FOOT INTERVALS, AND ADJACENT TO ALL RIGID OBJECTS. JOINTS SHALL MATCH LOCATIONS WITH JOINTS IN ABUTTING SIDEWALK.
- 4. CONCRETE COMPRESSIVE STRENGTH SHALL BE 3600 PSI IN 28 DAYS.
- 5. CURB SHALL BE DEPRESSED AT INTERSECTIONS TO PROVIDE FOR FUTURE ACCESSIBLE RAMPS.
- 6. TOP 6" OF SUBGRADE BENEATH THE CURB AND GUTTER SHALL BE COMPACTED TO 100% STANDARD PROCTOR DENSITY.

	REVISIONS		
DATE	DESCRIPTION		
то	WN OF KNIGHTDALE		
STANDARD DETAILS		CURB AND GUTTER	