

SMALL RADIUS LESS THAN 15'

CONCRETE DEPTH


SIDE RAMPS 4"
LANDING & CURB RAMPS 6"

(1) 8.33% (12:1) MAX RAMP SLOPE

(2) CROSS SLOPE: 2.00%

3 CURB RAMPS REQUIRE A (4'-0") MINIMUM LANDING WITH A MAXIMUM CROSS SLOPE AND LONGITUDINAL SLOPE OF 2.00% WHERE PEDESTRIANS PERFORM TURNING MANEUVERS. SLOPE TO DRAIN TO CURB.

(4) RAMPS SHALL BE INSTALLED THE SAME WIDTH AS THE SIDEWALK.

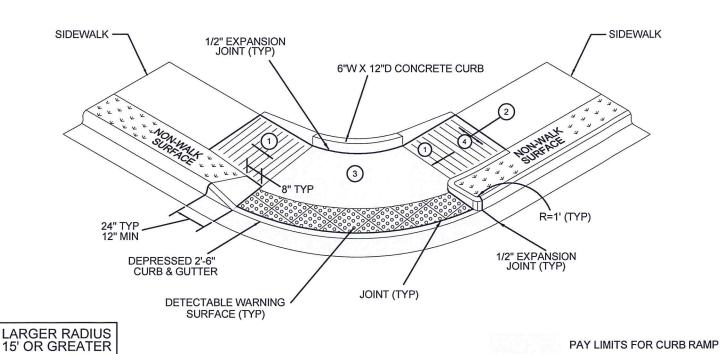

	REVISIONS	
DATE	DESCRIPTION	
_		

ONLY TO BE USED WITH TOWN OF KNIGHTDALE APPROVAL.

6 of 8 STD. NO.

TOWN OF KNIGHTDALE STANDARD DETAILS

SHARED CURB RAMPS/FLARED (RETROFIT)

4.06-6