


**NOTES:**

1. EITHER SOLID BRICK, SOLID BLOCK, OR PRECAST CONCRETE MAY BE USED.
2. PRECAST CONCRETE WALLS SHALL BE 6" THICK MINIMUM.
3. ALL CONCRETE SHALL BE 3000 P.S.I.
4. FOR 24" PIPE AND LARGER USE PIPE DIA. PLUS 12" AS INSIDE DIMENSIONS.

**PROFILE**

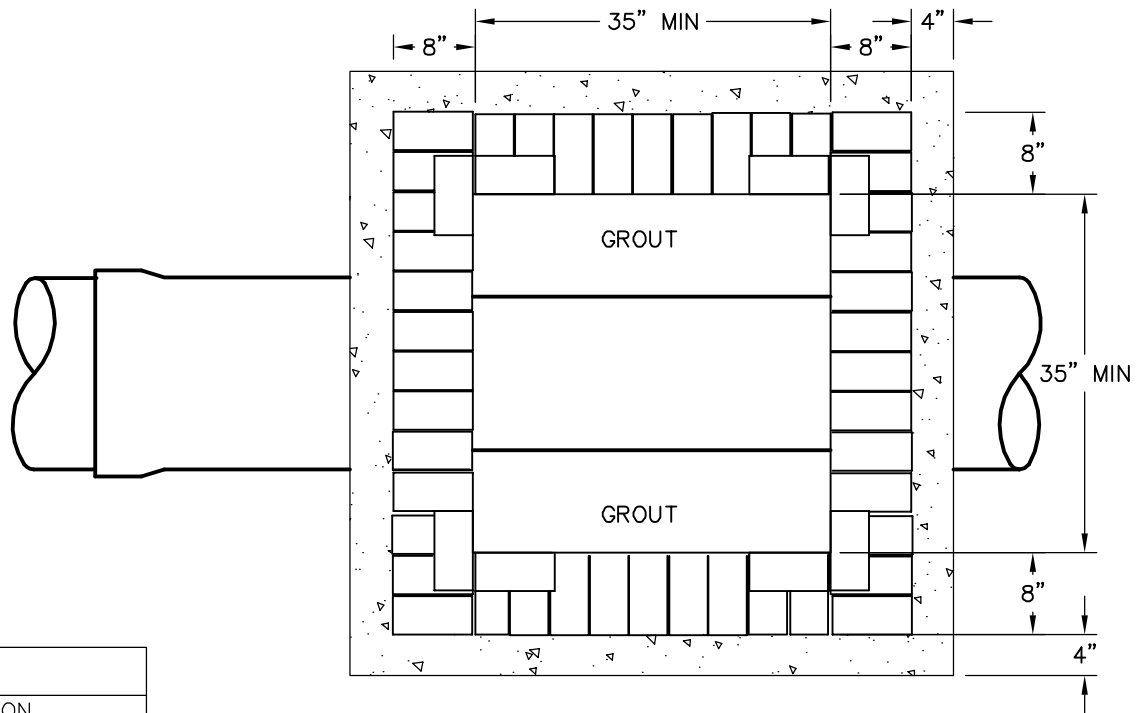

**PLAN VIEW**

REVISIONS	
DATE	DESCRIPTION

**TOWN OF KNIGHTDALE  
STANDARD DETAILS**

**STANDARD DROP INLET  
WITH GRATE AND FRAME**

STD. NO.

5.04